



STRUCTURAL FRAMING OF DECONTAMINATION UNIT

NOTE:


1. ALL LUMBER, PLYWOOD, AND SCAFFOLD PLANKING AT THE WORK-SITE SHALL BE TREATED FIRE RETARDANT AND BEAR A U.L. DESIGNATED RATING FR-S.
2. ALL POLYETHYLENE SHEETING AT THE WORKSITE SHALL BE 6-MIL THICKNESS OR GREATER AND SHALL BEAR A FIRE RETARDANT DESIGNATION CONFORMING TO NFPA STANDARD 701, "LARGE SCALE FLAMMABILITY TEST".

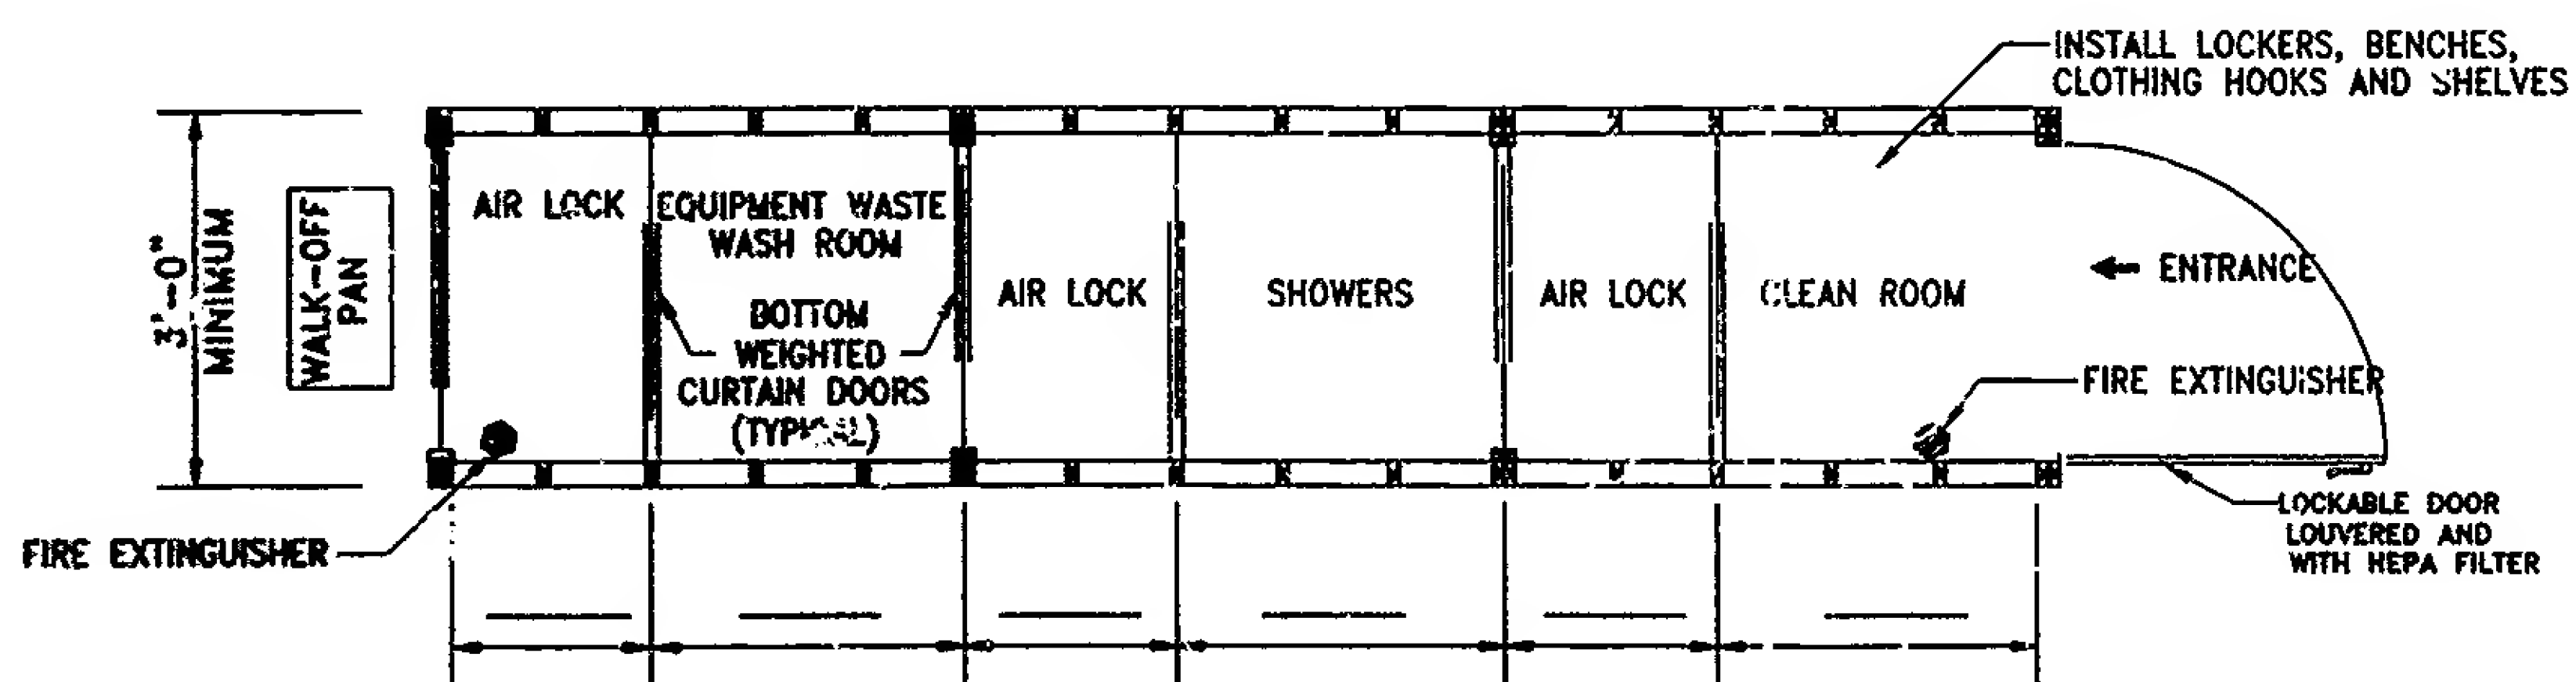

TYPICAL WORKER DECONTAMINATION ENCLOSURE  
(SHALL BE DIMENSIONED ON SHOP DRAWINGS)

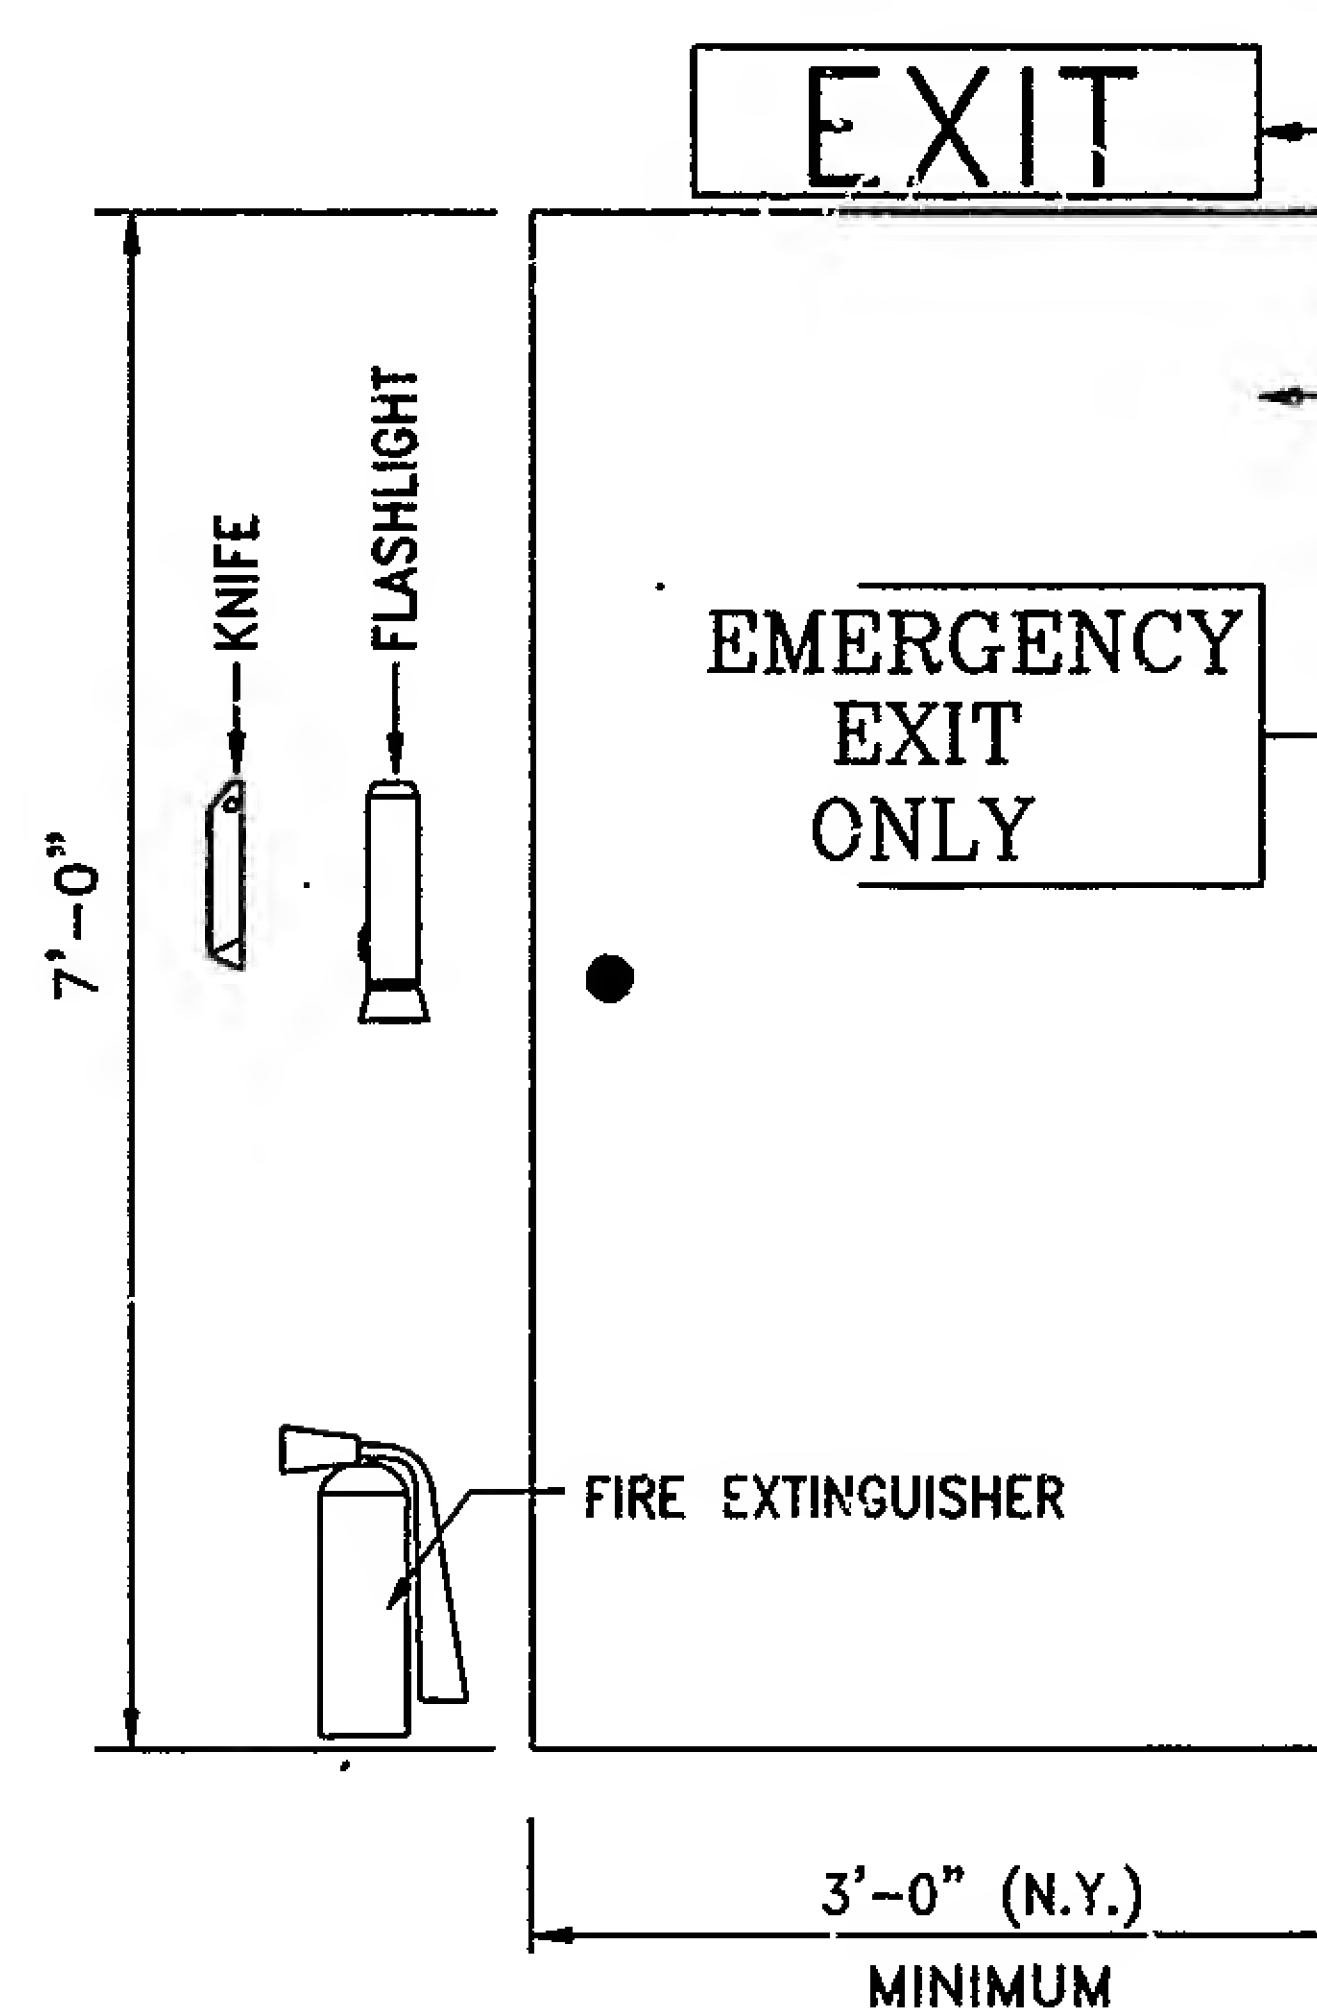

EMERGENCY EXIT (WORKER)

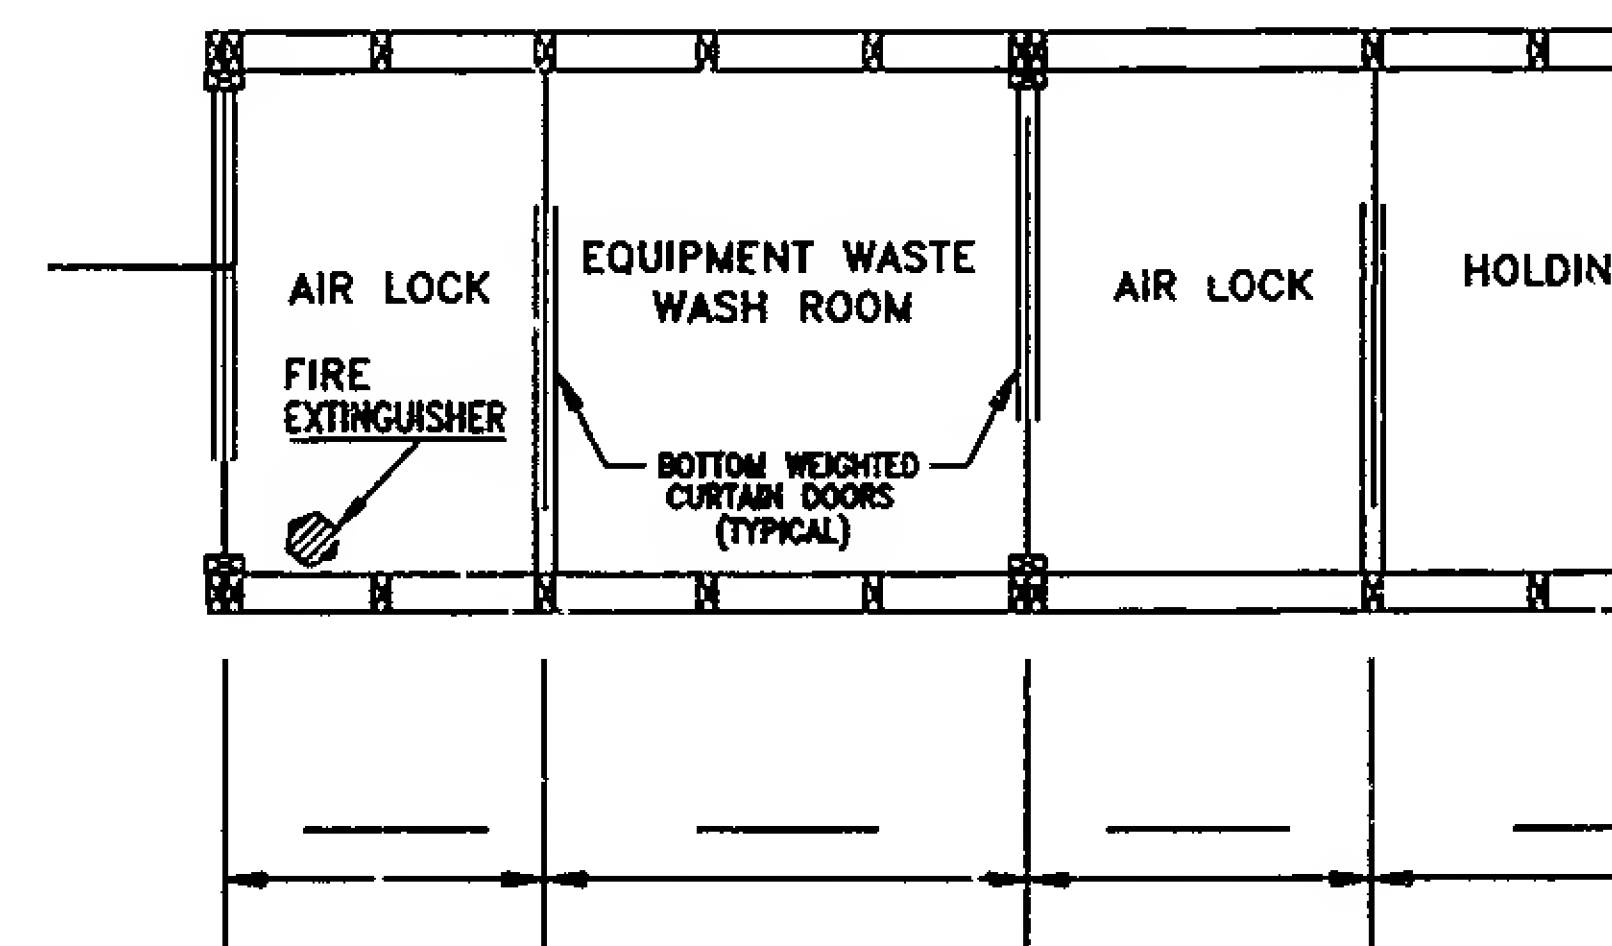

TYPICAL WASTE DECONTAMINATION ENCLOSURE  
(SHALL BE DIMENSIONED ON SHOP DRAWINGS)